


MUSTRA STATION

'B' CLASS STD -III(R)

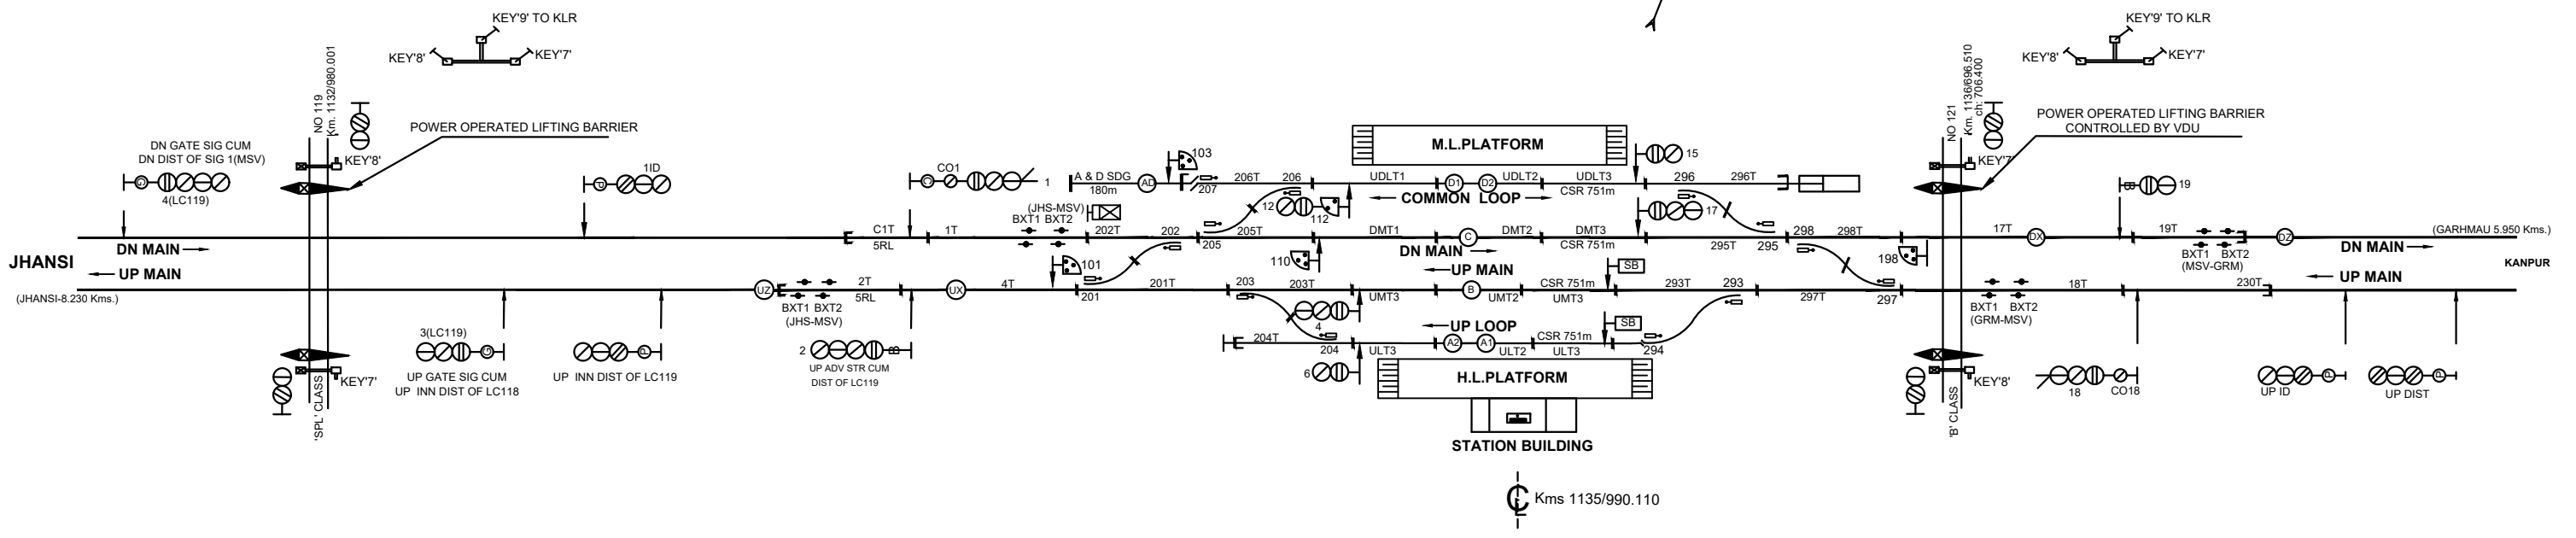

TO SUIT SIP NO.2301
'B' CLASS STD -III(R)